



PLAN FOR 18" OR LESS PIPE

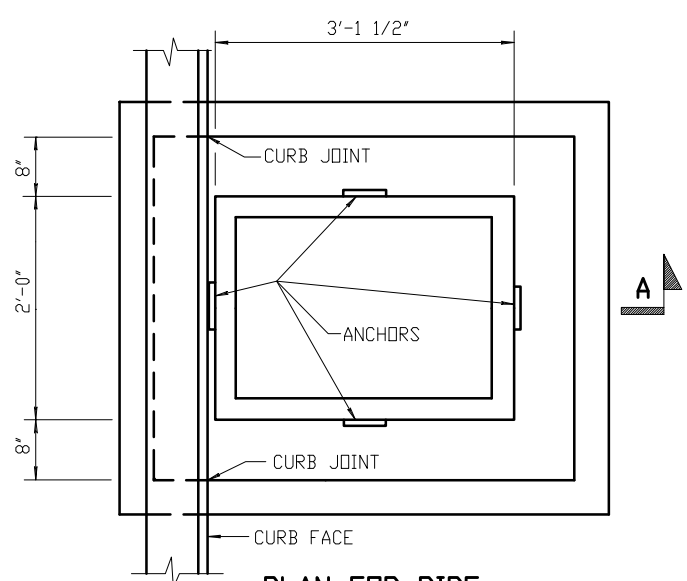


**PLAN FOR PIPE
GREATER THAN 18" UP TO 24"**

CONCRETE CURB, ITEM 609.04
GRANITE CURB, ITEM 609.02

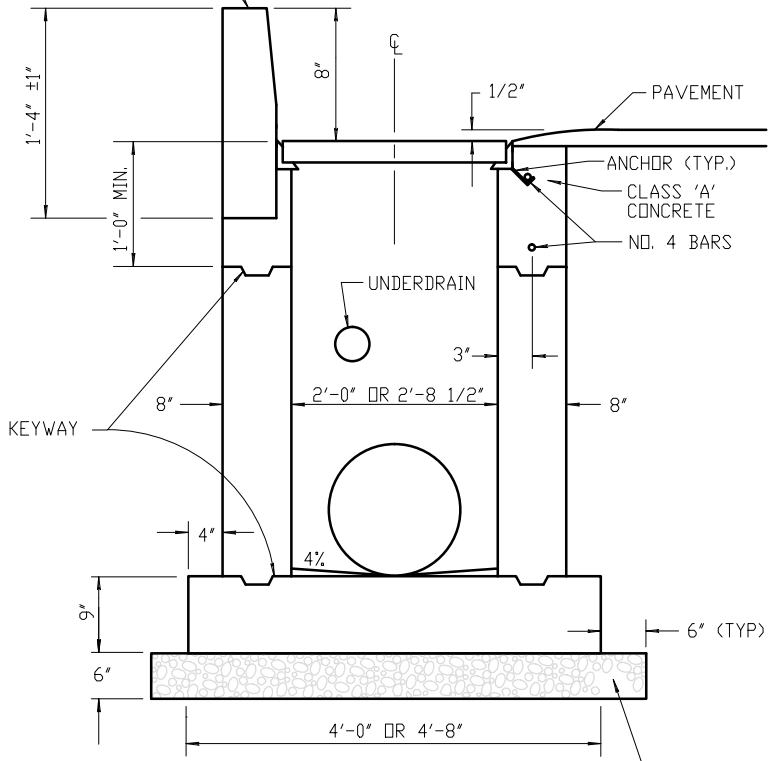

SECTION A-A

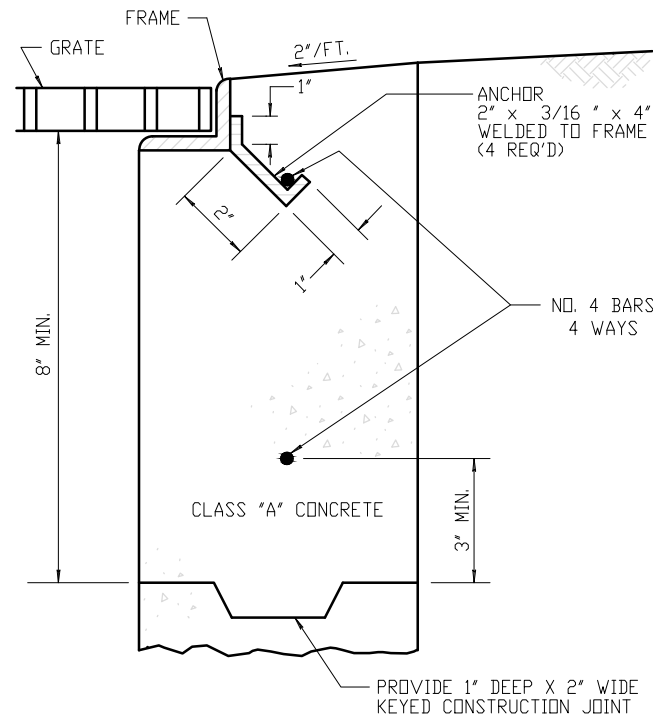

KEYWAY DETAIL

NOTES:

- ITEM 655.1111 WELDED FRAME & RETICULINE GRATE 11 - SEE N.Y.S.D.D.T. STANDARD SHEET 655-04.
- REINFORCEMENT SHALL HAVE A COVER OF 2" UNLESS OTHERWISE SHOWN. THE COST OF ALL BAR REINFORCEMENT SHALL BE INCLUDED IN THE PRICE BID FOR DROP INLETS.
- ALL CONCRETE FOR DROP INLETS SHALL BE CLASS "A". BENCHES SHALL BE CAST-IN-PLACE. COST TO BE INCLUDED IN DROP INLET ITEM.
- FILL WITH CEMENT MORTAR AND SEAL WITH ASPHALT EMULSION TACK COAT BETWEEN FRAME AND CURB. PAYMENT SHALL BE INCLUDED IN APPROPRIATE CURB ITEM.
- WHEN APPLICABLE EXTERIORS OF ALL DROP INLETS SHALL BE COATED WITH TWO COATS OF HIGH BUILD COAL TAR PAINT. AFTER INSTALLATION IS COMPLETE AND THE BENCH IS INSTALLED, THE INTERIOR OF ALL DROP INLETS SHALL BE COATED WITH TWO COATS OF EPOXY RESIN DAMP PROOFING.
- ALL PIPE CONNECTION TO STRUCTURE SHALL BE SEALED WITH 100% MORTAR.
- REFER TO FRAME AND GRATE ANCHOR DETAIL.
- STEPS WILL NOT BE ALLOWED.